



PROTECTOSE
FLAMMABLE LIQUID STORAGE
Model No. 5545-M
45 Gallon / 170 Litres
APPROVED OSHA
Complies in accordance with storage cabinet requirements for
flammable liquid storage inside buildings as set forth in OSHA regulations
Safety without compromise

**RIGHT-TO-KNOW
INFORMATION**

MATERIAL
SAFETY
DATA
SHEETS
S101

FLAMMABLE
KEEP FIRE AWAY
INFLAMMABLE
MANTENGASE ALEJADO DEL FUEGO
INFLAMMABLE
TENIR ÉLOIGNÉ DU FEU



PROTECTOSEAL



THE PROTECTOSEAL COMPANY
225 Foster Avenue, Bensenville, IL 60106
Phone 1-630-595-0800

SAFETY WITHOUT COMPROMISE
ISO 9001 QUALITY SYSTEM

5560MS
4200 60 GALLON
(226 LITRES)

Flammable Liquids Storage Cabinet



Constructed in accordance with
storage cabinet requirements for
flammable liquid storage inside buildings
as set forth in NFPA CODE #30

GLASS CLEANER

RUST OFF

TAMPONS


3

INFLAMMABLE

TENIR ÉLOIGNÉ DU FEU

FLAMMABLE

KEEP FIRE AWAY

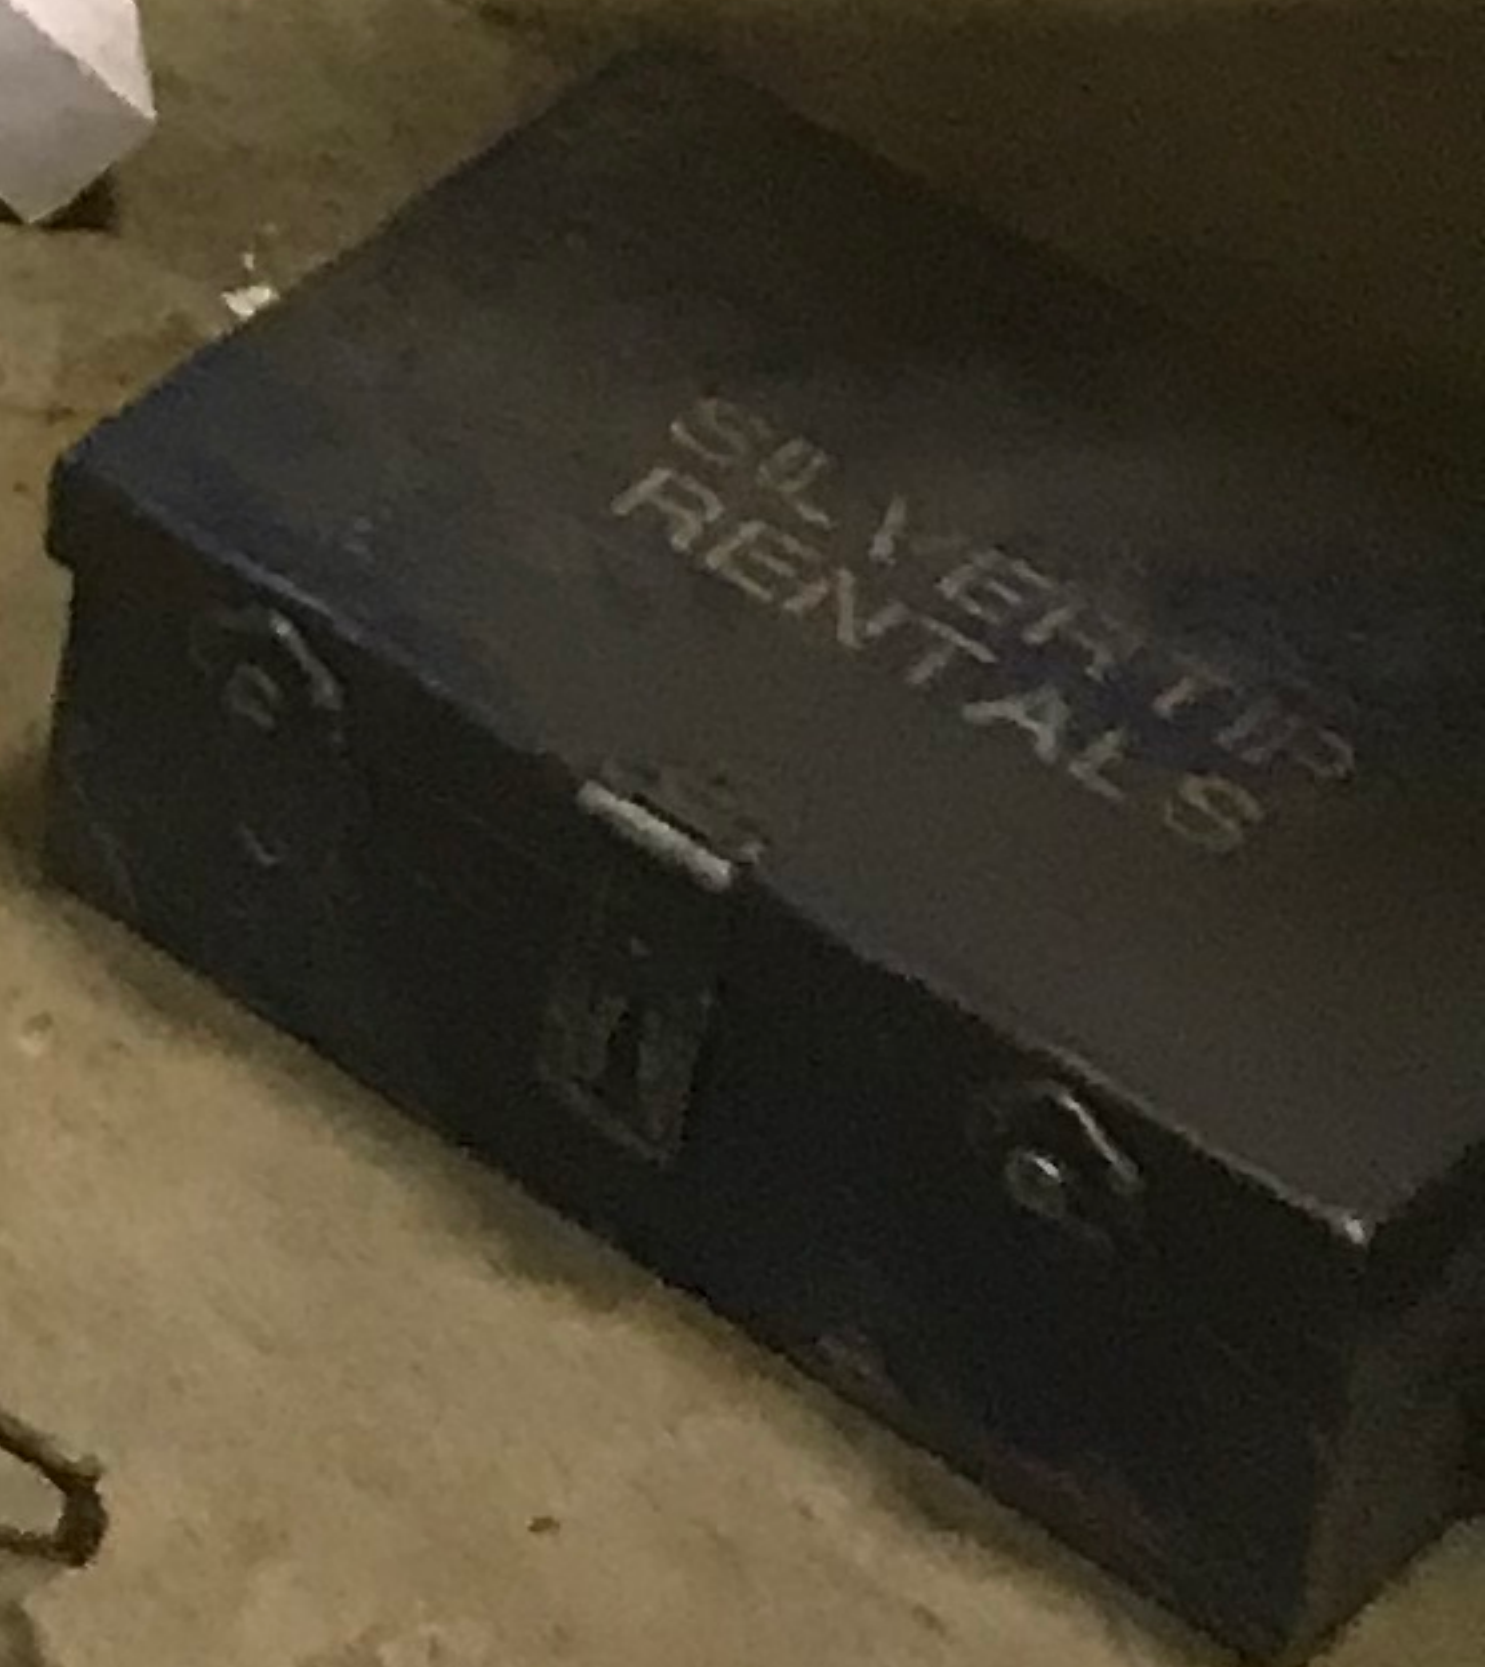



EAGLE MANUFACTURING
2400 CHARLES ST
WELLSBURG, WV
MODEL - 1947
45 GAL. CAPACITY
SAFETY STORAGE CABINET APPROVED
CONSTRUCTED IN ACCORDANCE WITH N.F.P.A. NO.
NATIONAL FIRE PROTECTION ASSOCIATION
MEETS OSHA REQUIREMENTS



PROPELLANT
STORAGE
MAXIMUM
50KGS

FLAMMABLE
KEEP FIRE AWAY



INFLAMABLE
MANTÉNGASE ALEJADO DEL FUEGO

INFLAMMABLE
GARDER LOIN DU FEU

